



PUBLIC WORKS

6215 Tuttle Creek Blvd  
Manhattan, Kansas 66503  
Phone: 785-537-6330  
Fax: 785-537-6331

June 22, 2015

Dear University Park Water User:

The Riley County Public Works Department is pleased to provide you with this Consumer Confidence Report for 2014. The Federal Safe Drinking Water Act of 1974 and subsequent amendments requires the University Park Water Benefit District to provide you with a "Consumer Confidence Report".

The University Park Water Benefit District purchases the water they supply you from Riley County Rural Water District # 1 who in turn purchases their water from the City of Manhattan. The enclosed 2014 Water Quality Reports are from testing performed within the University Park system, the Rural Water District system and from the City of Manhattan all which will serve as your "Consumer Confidence Report". The drinking water provided continues to meet or exceed all Federal and State standards.

Drinking water may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791).

If you are interested in more detail regarding the federal Safe Drinking Water Act of 1974 and subsequent amendments, I suggest you go to EPA's web site at <http://www.epa.gov/safewater/sdwa/sdwa.html>.

For more information you can contact the people listed on the City's Report, contact me at 785-537-6330 or email at [lhobson@rileycountyks.gov](mailto:lhobson@rileycountyks.gov).

Respectfully,

A handwritten signature in blue ink that reads "Leon Hobson". The signature is written in a cursive, flowing style.

Leon Hobson, P.E.  
Director of Public Works

Copy: University Park Water Benefit District  
[www.rileycountyks.gov](http://www.rileycountyks.gov)

Attachments: University Park Water Benefit District CCR  
Riley County Rural Water District #1 CCR  
City of Manhattan CCR

# UNIVERSITY PARK WATER DISTRICT

## Consumer Confidence Report – 2015

### Covering Calendar Year – 2014



This brochure is a snapshot of the quality of the water that we provided last year. Included are the details about where your water comes from, what it contains, and how it compares to Environmental Protection Agency (EPA) and state standards. We are committed to providing you with information because informed customers are our best allies. If you would like to observe the decision-making process that affect drinking water quality, please call Leon Hobson at 785-537-6330.

Our drinking water is supplied from another water system through a Consecutive Connection (CC). Your water comes from :

Buyer Name	Seller Name
University Park Water District	Riley Co RWD 1
Riley Co RWD 1	City Of Manhattan

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as those with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791).

The sources of drinking water (both tap water and bottled water) included rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in sources water before we treat it include:  
Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, livestock operations and wildlife.  
Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.  
Pesticides and herbicides, which may come from a variety of sources such as storm water run-off, agriculture, and residential users.  
Radioactive contaminants, which can be naturally occurring or the result of mining activity.  
Organic contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and also come from gas stations, urban storm water run-off, and septic systems.

In order to ensure that tap water is safe to drink, EPA prescribes regulation which limits the amount of certain contaminants in water provided by public water systems. We treat our water according to EPA's regulations. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

Our water system is required to test a minimum of 2 samples per month in accordance with the Total Coliform Rule for microbiological contaminants. Coliform bacteria are usually harmless, but their presence in water can be an

indication of disease-causing bacteria. When coliform bacteria are found, special follow-up tests are done to determine if harmful bacteria are present in the water supply. If this limit is exceeded, the water supplier must notify the public.

#### Water Quality Data

The following tables list all of the drinking water contaminants which were detected during the 2014 calendar year. The presence of these contaminants does not necessarily indicate the water poses a health risk. Unless noted, the data presented in this table is from the testing done January 1- December 31, 2014. The state requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants are not expected to vary significantly from year to year. Some of the data, though representative of the water quality, is more than one year old. **The bottom line is that the water that is provided to you is safe.**

#### Terms & Abbreviations

**Maximum Contaminant Level Goal (MCLG):** the "Goal" is the level of a contaminant in drinking water below which there is no known or expected risk to human health. MCLGs allow for a margin of safety.

**Maximum Contaminant Level (MCL):** the "Maximum Allowed" MCL is the highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

**Secondary Maximum Contaminant Level (SMCL):** recommended level for a contaminant that is not regulated and has no MCL.

**Action Level (AL):** the concentration of a contaminant that, if exceeded, triggers treatment or other requirements.

**Treatment Technique (TT):** a required process intended to reduce levels of a contaminant in drinking water.

Maximum

**Maximum Residual Disinfectant Level (MRDL):** the highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**Non-Detects (ND):** lab analysis indicates that the contaminant is not present.

**Parts per Million (ppm)** or milligrams per liter (mg/l)

**Parts per Billion (ppb)** or micrograms per liter (µg/l)

**Picocuries per Liter (pCi/L):** a measure of the radioactivity in water.

**Millirems per Year (mrem/yr):** measure of radiation absorbed by the body.

**Monitoring Period Average (MPA):** An average of sample results obtained during a defined time frame, common examples of monitoring periods are monthly, quarterly and yearly.

**Nephelometric Turbidity Unit (NTU):** a measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person. Turbidity is not regulated for groundwater systems.

**Running Annual Average (RAA):** an average of sample results obtained over the most current 12 months and used to determine compliance with MCLs.

**Testing Results for: UNIVERSITY PARK WATER DISTRICT**

Disinfection Byproducts	Monitoring Period	Your Highest RAA	Range (low/high)	Unit	MCL	MCLG	Typical Source
TOTAL HALOACETIC ACIDS (HAA5)	2014	19	19	ppb	60	0	By-product of drinking water disinfection
TTHM	2014	22	22	ppb	80	0	By-product of drinking water chlorination

Lead and Copper	Monitoring Period	90 <sup>th</sup> Percentile	Range (low/high)	Unit	AL	Sites Over AL	Typical Source
COPPER, FREE	2012 - 2014	0.032	0.0021 - 0.05	ppm	1.3	0	Corrosion of household plumbing
LEAD	2012 - 2014	2.4	4.8	ppb	15	0	Corrosion of household plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Your water system is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

During the 2014 calendar year, we had no violation(s) of drinking water regulations.

Some or all of our drinking water is supplied from another water system. The table below lists all of the drinking water contaminants, which were detected during the 2014 calendar year from the water systems that we purchase drinking water from.

Regulated Contaminants	Collection Date	Water System	Your Highest Value	Range (low/high)	Unit	MCL	MCLG	Typical Source
ARSENIC	5/7/2014	CITY OF MANHATTAN	2.5	2.5	ppb	10	0	Erosion of natural deposits
BARIUM	5/7/2014	CITY OF MANHATTAN	0.053	0.053	ppm	2	2	Discharge from metal refineries
CHROMIUM	5/7/2014	CITY OF MANHATTAN	1.8	1.8	ppb	100	100	Discharge from steel and pulp mills
FLUORIDE	7/28/2014	CITY OF MANHATTAN	0.91	0.73 - 0.91	ppm	4	4	Natural deposits; Water additive which promotes strong teeth.
NITRATE	5/7/2014	CITY OF MANHATTAN	0.23	0.23	ppm	10	10	Runoff from fertilizer use

Secondary Contaminants	Collection Date	Water System	Your Highest Value	Range (low/high)	Unit	SMCL
ALKALINITY, TOTAL	5/7/2014	CITY OF MANHATTAN	59	59	MG/L	300
CALCIUM	5/7/2014	CITY OF MANHATTAN	23	23	MG/L	200
CHLORIDE	5/7/2014	CITY OF MANHATTAN	53	53	MG/L	250
CONDUCTIVITY @ 25 C UMHOS/CM	5/7/2014	CITY OF MANHATTAN	470	470	UMHO/CM	1500
CORROSIVITY	5/7/2014	CITY OF MANHATTAN	0.89	0.89	LANG	0
HARDNESS, TOTAL (AS CaCO3)	5/7/2014	CITY OF MANHATTAN	110	110	MG/L	400
MAGNESIUM	5/7/2014	CITY OF MANHATTAN	14	14	MG/L	150
MANGANESE	5/7/2014	CITY OF MANHATTAN	0.0033	0.0033	MG/L	0.05
PH	5/7/2014	CITY OF MANHATTAN	9.4	9.4	PH	8.5
PHOSPHORUS, TOTAL	3/9/2011	CITY OF MANHATTAN	0.2	0.2	MG/L	5
POTASSIUM	5/7/2014	CITY OF MANHATTAN	7.2	7.2	MG/L	100
SILICA	5/7/2014	CITY OF MANHATTAN	22	22	MG/L	50
SODIUM	5/7/2014	CITY OF MANHATTAN	45	45	MG/L	100
SULFATE	5/7/2014	CITY OF MANHATTAN	74	74	MG/L	250
TDS	5/7/2014	CITY OF MANHATTAN	280	280	MG/L	500

During the 2014 calendar year, the water systems that we purchase water from had no violation(s) of drinking water regulations.

**Please Note: Because of sampling schedules, results may be older than 1 year.**

# RILEY CO RWD 1

## Consumer Confidence Report – 2015

### Covering Calendar Year – 2014

This brochure is a snapshot of the quality of the water that we provided last year. Included are the details about where your water comes from, what it contains, and how it compares to Environmental Protection Agency (EPA) and state standards. We are committed to providing you with information because informed customers are our best allies. If you would like to observe the decision-making process that affect drinking water quality, please call CHRIS OLSSON at 785-537-4440.

Our drinking water is supplied from another water system through a Consecutive Connection (CC). Your water comes from :

Buyer Name	Seller Name
RILEY CO RWD 1	CITY OF MANHATTAN

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as those with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791).

The sources of drinking water (both tap water and bottled water) included rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in sources water before we treat it include:

- Microbial contaminants**, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, livestock operations and wildlife.
- Inorganic contaminants**, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.
- Pesticides and herbicides**, which may come from a variety of sources such as storm water run-off, agriculture, and residential users.
- Radioactive contaminants**, which can be naturally occurring or the result of mining activity.
- Organic contaminants**, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and also come from gas stations, urban storm water run-off, and septic systems.

In order to ensure that tap water is safe to drink, EPA prescribes regulation which limits the amount of certain contaminants in water provided by public water systems. We treat our water according to EPA's regulations. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

Our water system is required to test a minimum of 2 samples per month in accordance with the Total Coliform Rule for microbiological contaminants. Coliform bacteria are usually harmless, but their presence in water can be an indication of disease-causing bacteria. When coliform bacteria are found, special follow-up tests are done to determine if harmful bacteria are present in the water supply. If this limit is exceeded, the water supplier must notify the public.

#### Water Quality Data

The following tables list all of the drinking water contaminants which were detected during the 2014 calendar year. The presence of these contaminants does not necessarily indicate the water poses a health risk. Unless noted, the data presented in this table is from the testing done January 1- December 31, 2014. The state requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants are not expected to vary significantly from year to year. Some of the data, though representative of the water quality, is more than one year old. **The bottom line is that the water that is provided to you is safe.**

#### Terms & Abbreviations

**Maximum Contaminant Level Goal (MCLG):** the "Goal" is the level of a contaminant in drinking water below which there is no known or expected risk to human health. MCLGs allow for a margin of safety.

**Maximum Contaminant Level (MCL):** the "Maximum Allowed" MCL is the highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

**Secondary Maximum Contaminant Level (SMCL):** recommended level for a contaminant that is not regulated and has no MCL.

**Action Level (AL):** the concentration of a contaminant that, if exceeded, triggers treatment or other requirements.

**Treatment Technique (TT):** a required process intended to reduce levels of a contaminant in drinking water.

Maximum

**Maximum Residual Disinfectant Level (MRDL):** the highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**Non-Detects (ND):** lab analysis indicates that the contaminant is not present.

**Parts per Million (ppm)** or milligrams per liter (mg/l)

**Parts per Billion (ppb)** or micrograms per liter (µg/l)

**Picocuries per Liter (pCi/L):** a measure of the radioactivity in water.

**Millirems per Year (mrem/yr):** measure of radiation absorbed by the body.

**Monitoring Period Average (MPA):** An average of sample results obtained during a defined time frame, common examples of monitoring periods are monthly, quarterly and yearly.

**Nephelometric Turbidity Unit (NTU):** a measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person. Turbidity is not regulated for groundwater systems.

**Running Annual Average (RAA):** an average of sample results obtained over the most current 12 months and used to determine compliance with MCLs.

**Testing Results for: RILEY CO RWD 1**

Microbiological	Result	MCL	MCLG	Typical Source
COLIFORM (TCR)	In the month of October, 2 samples returned as positive	MCL: Systems that Collect Less Than 40 Samples per Month - No more than 1 positive monthly sample	0	Naturally present in the environment
E. COLI	In the month of October, 1 sample returned as positive	MCL: A Routine Sample and a Repeat Sample are Total Coliform Positive, and One is also Fecal Positive/E. Coli Positive	0	Human and animal fecal waste

Disinfection Byproducts	Monitoring Period	Your Highest RAA	Range (low/high)	Unit	MCL	MCLG	Typical Source
TOTAL HALOACETIC ACIDS (HAA5)	2014	16	16	ppb	60	0	By-product of drinking water disinfection
TTHM	2014	17	17	ppb	80	0	By-product of drinking water chlorination

Lead and Copper	Monitoring Period	90 <sup>th</sup> Percentile	Range (low/high)	Unit	AL	Sites Over AL	Typical Source
COPPER, FREE	2012 - 2014	0.028	0.0082 - 0.033	ppm	1.3	0	Corrosion of household plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Your water system is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

During the 2014 calendar year, we had the below noted violation(s) of drinking water regulations.

Compliance Period	Analyte	Type
10/1/2014 - 10/31/2014	COLIFORM (TCR)	MCL (TCR), ACUTE
10/1/2014 - 10/31/2014	COLIFORM (TCR)	MCL (TCR), MONTHLY

Some or all of our drinking water is supplied from another water system. The table below lists all of the drinking water contaminants, which were detected during the 2014 calendar year from the water systems that we purchase drinking water from.

Regulated Contaminants	Collection Date	Water System	Your Highest Value	Range (low/high)	Unit	MCL	MCLG	Typical Source
ARSENIC	5/7/2014	CITY OF MANHATTAN	2.5	2.5	ppb	10	0	Erosion of natural deposits
BARIUM	5/7/2014	CITY OF MANHATTAN	0.053	0.053	ppm	2	2	Discharge from metal refineries
CHROMIUM	5/7/2014	CITY OF MANHATTAN	1.8	1.8	ppb	100	100	Discharge from steel and pulp mills
FLUORIDE	7/28/2014	CITY OF MANHATTAN	0.91	0.73 - 0.91	ppm	4	4	Natural deposits; Water additive which promotes strong teeth.
NITRATE	5/7/2014	CITY OF MANHATTAN	0.23	0.23	ppm	10	10	Runoff from fertilizer use

Secondary Contaminants	Collection Date	Water System	Your Highest Value	Range (low/high)	Unit	SMCL
ALKALINITY, TOTAL	5/7/2014	CITY OF MANHATTAN	59	59	MG/L	300
CALCIUM	5/7/2014	CITY OF MANHATTAN	23	23	MG/L	200
CHLORIDE	5/7/2014	CITY OF MANHATTAN	53	53	MG/L	250
CONDUCTIVITY @ 25 C UMHOS/CM	5/7/2014	CITY OF MANHATTAN	470	470	UMHO/CM	1500
CORROSIVITY	5/7/2014	CITY OF MANHATTAN	0.89	0.89	LANG	0
HARDNESS, TOTAL (AS CACO3)	5/7/2014	CITY OF MANHATTAN	110	110	MG/L	400
MAGNESIUM	5/7/2014	CITY OF MANHATTAN	14	14	MG/L	150
MANGANESE	5/7/2014	CITY OF MANHATTAN	0.0033	0.0033	MG/L	0.05
PH	5/7/2014	CITY OF MANHATTAN	9.4	9.4	PH	8.5
PHOSPHORUS, TOTAL	3/9/2011	CITY OF MANHATTAN	0.2	0.2	MG/L	5

Secondary Contaminants	Collection Date	Water System	Your Highest Value	Range (low/high)	Unit	SMCL
POTASSIUM	5/7/2014	CITY OF MANHATTAN	7.2	7.2	MG/L	100
SILICA	5/7/2014	CITY OF MANHATTAN	22	22	MG/L	50
SODIUM	5/7/2014	CITY OF MANHATTAN	45	45	MG/L	100
SULFATE	5/7/2014	CITY OF MANHATTAN	74	74	MG/L	250
TDS	5/7/2014	CITY OF MANHATTAN	280	280	MG/L	500

During the 2014 calendar year, the water systems that we purchase water from had no violation(s) of drinking water regulations.

**Additional Required Health Effects Language:**

Fecal coliforms and E. coli are bacteria whose presence indicates that the water may be contaminated with human or animal wastes. Microbes in these wastes can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a special health risk for infants, young children, some of the elderly, and people with severely compromised immune systems.

Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other potentially harmful bacteria may be present. Coliforms were found in more samples than allowed and this was a warning of potential problems.

**Please Note: Because of sampling schedules, results may be older than 1 year.**

## How often is your water tested?

The City of Manhattan tests water throughout the treatment process, when it reaches the water towers and at various locations throughout the distribution system.

In addition to manual testing, we use online analyzers that continuously test the water before, during and after the treatment process for pH, conductivity, turbidity, free chlorine, total chlorine and other physical properties.

Water from six storage reservoirs is tested weekly by environmental staff for pH, chlorine, ammonia and other parameters. Finished water, or water that has been through the water treatment process, is regularly tested.

The following tests are conducted at our in-house laboratory:

- Every 4 hours: Hardness, pH, total chlorine, and turbidity
- Every 8 hours: Total dissolved solids
- Every 24 hours: Fluoride and free ammonia

We also collect the following samples and submit them to the KDHE laboratory in Topeka:

- Monthly: Coliform bacteria (60 samples from the distribution system)
- Quarterly: Trihalomethanes/haloacetic acids, fluoride
- Annually: Nitrate, synthetic organic compounds and volatile organic compounds
- Tri-Annually: Lead, copper, regulated and unregulated inorganic contaminants

## Our commitment to our customers

Year after year, we deliver on a promise to provide safe and reliable drinking water. This promise demands foresight, investment and long-range planning. Monitoring and treatment are key methods by which we protect the public water supply.

The Big Blue and Kansas rivers constitute two of Manhattan's most important natural resources. With the City's 20 public water supply wells near their confluence, protecting the wellfield is a vital public service that remains a top priority.

Since 1999, we have participated in a voluntary wellfield water quality monitoring program, testing the untreated water directly from the 20 public water supply wells.

Find more information at [www.cityofmhk.com/water](http://www.cityofmhk.com/water).



**Public Works Department**  
Water and Wastewater Division  
(785) 587-4530  
[www.cityofmhk.com/water](http://www.cityofmhk.com/water)

**Randy D. DeWitt, P.E.**  
Assistant Director of Public Works  
[dewitt@cityofmhk.com](mailto:dewitt@cityofmhk.com)

**Abdu Durar, Ph.D.**  
Environmental Compliance Manager  
[durar@cityofmhk.com](mailto:durar@cityofmhk.com)



# 2014 Water Quality Report

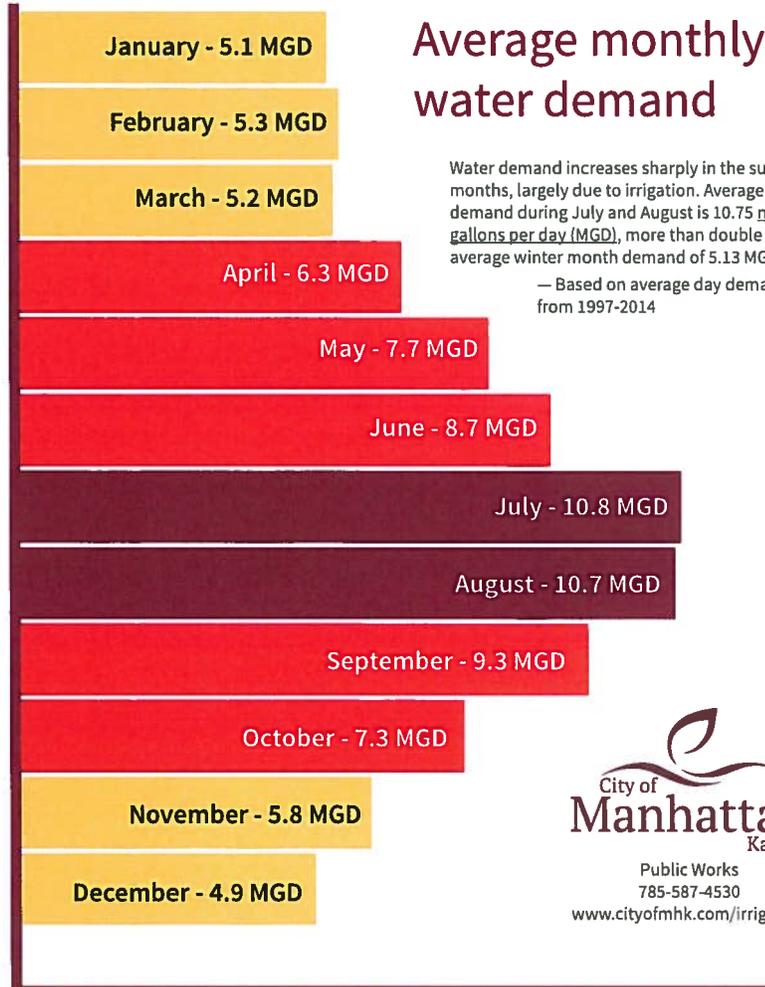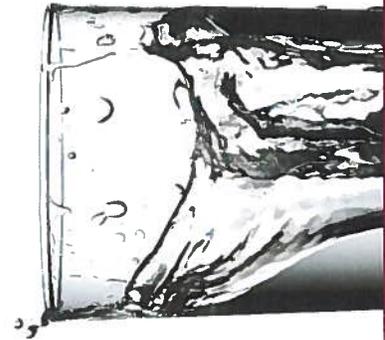

## Take the irrigation initiative

The majority of sprinkler systems in Manhattan are scheduled to water on Mondays, Wednesdays and Fridays. This significantly increases water demand on those days and can place stress on the city's water system.

Please consider switching watering days on your sprinkler system to Tuesday, Thursday and Saturday. This will help spread water demand throughout the week and take a little pressure off our water system during the critical summer months.

— Usage from July 20-26, 2014, at roughly 5 a.m.



# WATER QUALITY DATA

This report is based upon tests conducted by the Kansas Department of Health and Environment (KDHE) on the finished water produced by the City of Manhattan's Water Treatment Plant. Unless otherwise noted, the data represent tests conducted between January 1 and December 31, 2014. Of the 87 contaminants regulated by the Environmental Protection Agency (EPA), only eleven (11) were detected in the compliance monitoring samples. However, two (2) of the detected contaminants (chloramines and fluoride) are added as part of the treatment process to improve water quality. All detected contaminants were below the Maximum Contaminant Level (MCL).

The following tables list the name of each substance, unit, MCLs, the amount detected and Maximum Contaminant Level Goal (MCLG). All regulated and some unregulated contaminants that were detected in the water collected, even in the most minute traces, are included. The footnotes explain the findings, and there is also a key to the units of measurement. MCL is defined as "the highest level of a contaminant that is allowed in drinking water." MCLG is "the level of a contaminant in drinking water below which there is no known or expected risk to health." MCLs are set as close to the MCLGs as feasible. MCLGs allow for a margin of safety.

## DETECTED REGULATED CONTAMINANTS

PARAMETER	AVERAGE LEVEL DETECTED	RANGE	MCL	MCLG	VIOLATION	SAMPLE DATE	LIKELY SOURCE
Arsenic (ppb)	2.5	2.5	10	0	No	May 7, 2014	Erosion of natural deposits; runoff from orchards; runoff from glass and electronics production waste
Barium (ppm)	0.053	0.053	2	2	No	May 7, 2014	Erosion of natural deposits; discharge from metal refineries; discharge of drilling wastes
Chloramines <sup>1</sup> (ppm)	2.49	1.68 - 3.33	4	4	No	January - December 2014	Water additive used to control microbes
Chromium (ppb)	1.8	1.8	100	100	No	May 7, 2014	Erosion of natural deposits; discharge from steel and pulp mills
Fluoride <sup>2</sup> (ppm)	0.79	0.73 - 0.91	4	4	No	January - December 2014	Water additive that promotes strong teeth
Nitrate (ppm)	0.23	0.23	10	10	No	May 7, 2014	Runoff from fertilizer use

## MICROBIOLOGICAL

BY-PRODUCT	RESULT	MCL	MCLG	TYPICAL SOURCE
Coliform (TCR)	In May, 1.6% of samples tested positive	No more than 5% of samples can test positive	0	Naturally present in the environment

In compliance with the Total Coliform Rule (TCR), the City of Manhattan is required to collect a minimum of 60 samples per month (720 per year) for bacteriological water monitoring. Coliform bacteria are usually harmless but their presence in water can be an indication of disease-causing bacteria. When Coliform bacteria are found, special follow-up tests are done to determine if harmful bacteria are present in the water supply. Any violation of drinking water microbiological standards requires issuing a public notice. In May 2014, Coliform bacteria were found in one sample. However, no bacteria were found in any follow-up tests. There was no violation and no public notice required.

## DISINFECTION BY-PRODUCTS

BY-PRODUCT	HIGHEST RAA <sup>3</sup>	RANGE	MCL	MCLG	VIOLATION	SAMPLE DATE	LIKELY SOURCE
Haloacetic Acids (HAA5s) (ppb)	12.5	6.9 - 15.0	60	N/A	No	January - December 2014	By-product of drinking water disinfection
Total Trihalomethanes (TTHMs) (ppb)	23.0	16.8 - 31.0	80	N/A	No	January - December 2014	By-product of drinking water disinfection

## METALS IN DRINKING WATER FROM HOME TAPS

The City of Manhattan is required to monitor corrosion of household plumbing systems by sampling in homes for lead and copper. KDHE requires these tests be performed every three years. With the cooperation of local homeowners, City staff will be collecting samples again in the summer of 2017. For more information on metals in drinking water, call the Safe Drinking Water Hotline at (800) 426-4791 or visit [www.epa.gov/safewater/lead](http://www.epa.gov/safewater/lead).

ANALYTE	90TH PERCENTILE <sup>4</sup>	RANGE	MCL	MCLG	VIOLATION	SAMPLE DATE	LIKELY SOURCE
Copper (ppm)	0.010	0.001 - 0.019	AL = 1.3	AL = 1.3	No	July - September 2014	Corrosion of household plumbing systems; corrosion of natural deposits; leaching of wood preservatives
Lead (ppb)	0.0	0.0 - 2.1	AL = 15	AL = 15	No	July - September 2014	Corrosion of household plumbing systems; erosion of natural deposits

## DETECTED UNREGULATED CONTAMINANTS

Unregulated contaminants are tested every three years. These samples were collected on May 7, 2014.

PARAMETER	LEVEL DETECTED	SMCL
Alkalinity as CaCO <sub>3</sub> (ppm)	59.0	300
Calcium (ppm)	23	200
Chloride (ppm)	53	250
Conductivity, Specific (µmhos/cm)	470	1500
Corrosivity (L)	0.89	0
<sup>5</sup> Hardness, Total (ppm)	110	400
Magnesium (ppm)	14	150
Manganese (ppm)	0.0033	0.05
pH (pH units)	9.4	8.5
Potassium (ppm)	7.2	100
Silica (ppm)	22	50
Sodium (ppm)	45	100
Solids, Total Dissolved (ppm)	280	500
Sulfate (ppm)	74	250

## KEY TO TABLES

**AL**=Action Level: Any samples that contain over this amount of a contaminant require corrosion control action by the utilities

**LI**=Langlier's Index: Used to reflect corrosion or deposition of scale deposits

**N/A**=Not Available

**ppb**=parts per billion or micrograms per liter (µg/L): One part per billion equals one penny per \$10,000,000

**ppm**=parts per million or milligrams per liter (mg/L): One part per million equals one penny per \$10,000

**SMCL**=Secondary Maximum Contaminant Level

**µmhos/cm**=micromhos per centimeter

## MESSAGE FROM THE ENVIRONMENTAL PROTECTION AGENCY

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791). The sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water before treatment include microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife; and inorganic contaminants, such as salts and metals. Inorganic contaminants may be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges; oil and gas production, mining or farming. Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses, can be found in source water. It is also possible to find radioactive contaminants in source

water, which can be naturally occurring or be the result of oil and gas production and mining activities. Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff and septic systems, may be present in source water. Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Center for Disease Control guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

In order to ensure that tap water is safe to drink, the EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. We treat our water according to EPA regulations. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

### SOURCE WATER ASSESSMENT REPORT

The City of Manhattan obtains its water from 20 groundwater wells. Raw water is treated to remove several contaminants, and disinfectants are added to protect against microbial contaminants. The Safe Drinking Water Act (SDWA) requires states to develop a Source Water Assessment (SWA) for each public water

supply that treats and distributes raw source water in order to identify potential contamination sources. The state of Kansas has completed an assessment of our source water. For results of the source water assessment, please contact us or view the results online at [www.kdhe.state.ks.us/nps/swap/SWreports.html](http://www.kdhe.state.ks.us/nps/swap/SWreports.html).

<sup>1</sup> Compliance is based on a Running Annual Average (RAA) of the most recent 12 months of testing. The RAA was 2.49 ppm for 2014. Since chloramines are added disinfectants, MCLs do not apply. The highest level allowed in drinking water is the Maximum Residual Disinfectant Level (MRDL). For chloramines, the highest level allowed is 4 ppm.

<sup>2</sup> Fluoride occurs naturally in very low concentrations. It is added at the Water Treatment Plant to promote dental health.

<sup>3</sup> KDHE regulations require the City to report the highest Running Annual Average (RAA) from 2014. The highest TTHMs and HAA5s RAAs occurred in the first quarter of 2014.

<sup>4</sup> In a ranking of 10 samples, the ninth highest sample is the value that represents the 90th percentile.

<sup>5</sup> Hardness can also be expressed in grains per gallon. To convert ppm to grains per gallon, divide by 17.1, (110 ppm=6.43 grains per gallon).